PLFY-WP32, 40, 50VBM-E

Unit : mm

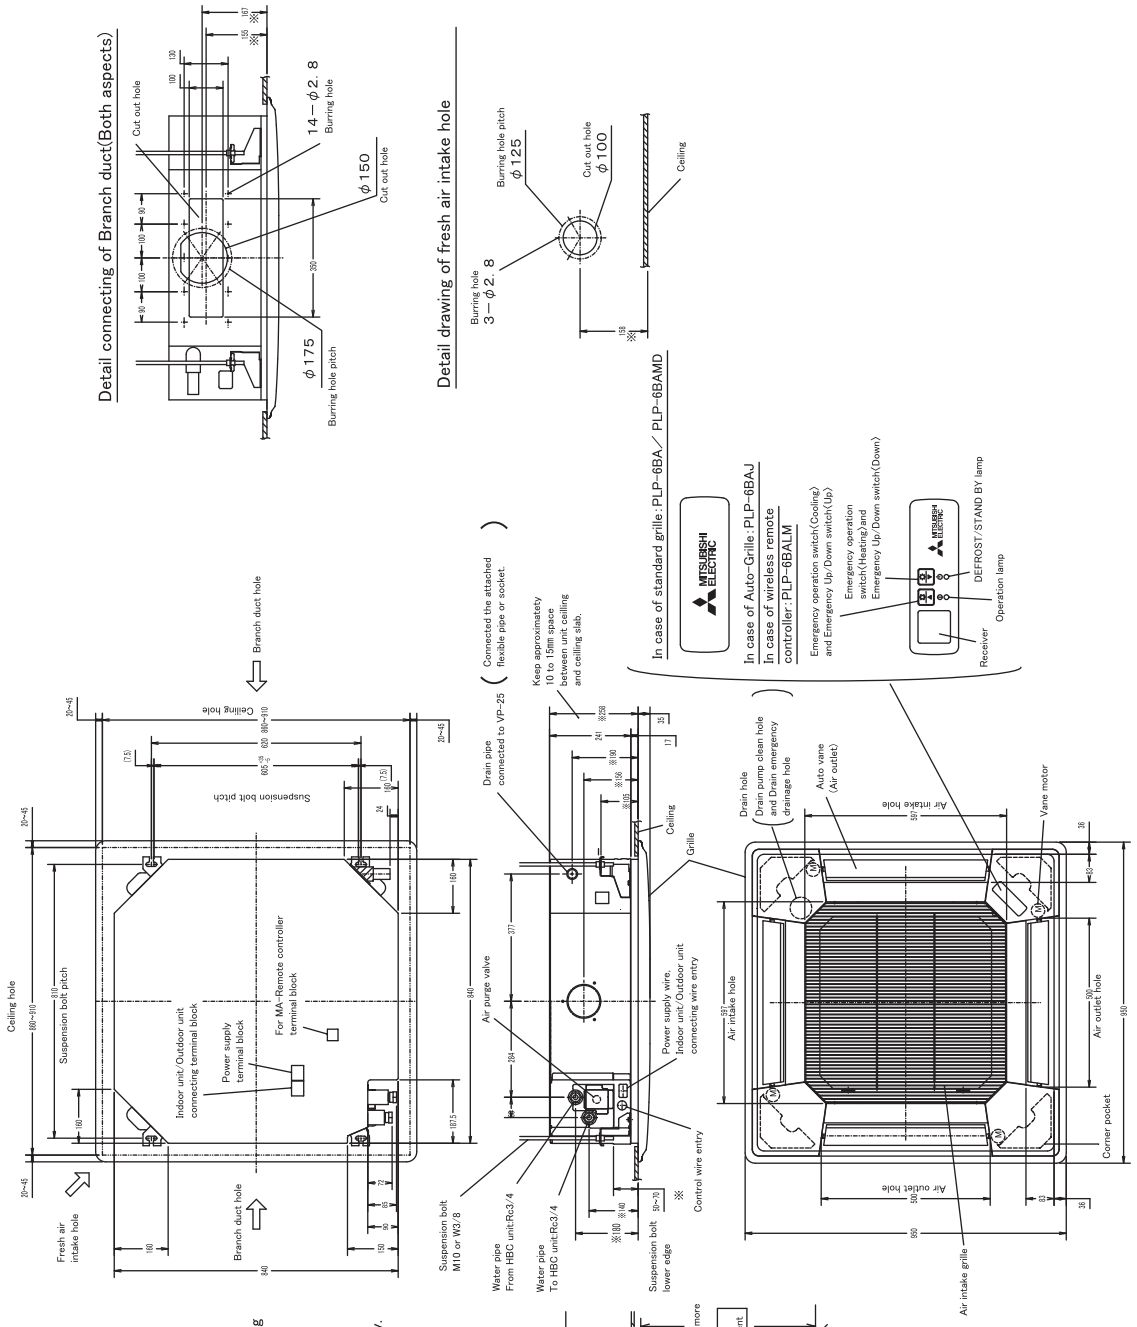

Note1. Please choose the Grille from a standard grille, Auto-Grille.
2. As for drain pipe, please use VP-25(O.D. φ32 PVC TUBE).
Drain pump inclusion.
Raise is max 850mm from the ceiling.
3. As for suspension bolt, please use M10 or W3/8.
(Procured at local site)
4. Electrical box may be removed for the service purpose.
Make sure to slack the electrical wire little bit for control/power wires connection.
5. The height of the indoor unit is able to be adjusted with the grille attached.
6. For the installation of the optional high efficiency filter or optional multi-functional casement.
(Reference of the 2nd sheet of detailed Figure)
1) Requires 400 mm or more space between transom and ceiling for the installation.
2) Add 135 mm to the dimensions ※ marked on the figure.
3) The optional high efficiency filter becomes optional multi-functional casement and concomitant use.
7. When installing the branch ducts, be sure to insulate adequately. Otherwise condensation and dripping may occur.
(It becomes the cause of dew drops/Wear dew.)
8. As for necessary installation/service space, please refer to the under at figure.